



# **RAINWATER HARVESTING PLANNING AS AN ALTERNATIVE FOR CLEAN WATER SUPPLY IN PUBLIC FACILITIES IN SEPAKU DISTRICT: A STUDY OF SUPPLY POTENTIAL USING PROBABILITY METHODS**

**Ika Meicahayanti<sup>1\*</sup>, Elvina Amalia Putri<sup>1</sup>, Mardewi Jamal<sup>2</sup>, Dharwati Pratama Sari<sup>2</sup>, Budi Haryanto<sup>2</sup>, Tamrin<sup>2</sup>, Agus Maryono<sup>3</sup>, and Arno Adi Kuntoro<sup>4</sup>**

<sup>1</sup>*Department of Environmental Engineering, Faculty of Engineering, Mulawarman University, Indonesia*

<sup>2</sup>*Department of Civil Engineering, Faculty of Engineering, Mulawarman University, Indonesia*

<sup>3</sup>*Departement of Civil Engineering, Vocational School, Universitas Gadjah Mada, Indonesia*

<sup>4</sup>*Departement of Civil Engineering, Faculty of Civil and Environmental Engineering, Institut Teknologi Bandung, Indonesia*

\* *Corresponding author: ika.meica@ft.unmul.ac.id*

## **ABSTRACT**

The clean water supply in Sepaku District covers only 15.27% of the total water demand. Efforts to utilise rainwater as an alternative source are necessary due to this region has high rainfall. The study aims to analyse the potential of rainwater discharge and design a Rainwater Harvesting (RWH) system to support clean water provision. The analysis was conducted on rainfall data using probability methods, calculations of potential rainwater discharge, and sizing of the RWH system components. The rainwater potential was calculated based on reliable rainfall, roof area, runoff coefficient, and first-flush volume. The RWH system design included determining suitable storage tank capacity, gutter specifications, and first-flush pipe dimensions. The results of this study indicate that the potential for rainwater harvesting and the design of the Rainwater Harvesting (RWH) system vary across buildings, depending on roof catchment area and rainwater availability. The rainwater potential discharge varies across locations, ranging from 109.3 to 434 m<sup>3</sup>/year, influenced by differences in roof area as catchment area. The RWH system planned consists of storage tank capacities of 2.2, 3.2, and 7.5 m<sup>3</sup>, horizontal pipes of 100–150 mm, vertical pipes of 75–125 mm, and first-flush pipes of 6 inches or 10 inches with a height of 1.45–3.38 m. This design is adjusted to the rainwater potential that can be applied in each building and is expected to become an alternative clean water supply.

**Keywords:** Clean-water, Design, Probability, Rainwater-harvesting-plan, Rainwater-potential.

## **1. Introduction**

The provision of clean water is the responsibility of local governments to support the availability and quality of clean water [1]. Sepaku District, North Penajam Paser Regency, is a district supplied with clean water by Perumdam Air Minum Danum Taka. Based on the data, Sepaku District is only served by 15.27% clean water [2] and does not yet meet the requirements for quality, quantity, and continuity. Clean water demand can be met by utilising nearby water sources [3]. The supply of clean water can be reduced if its use is not properly regulated, so it is necessary to conserve water resources by maintaining water availability, saving water resources, and utilising rainwater as an alternative water source [4].

Rainwater is a high-quality water source and can reduce the use of clean water sources [5]. Rainwater quality varies depending on environmental conditions and rainwater harvesting media [6]. Based on research conducted on the application of the concept of rainwater harvesting as an alternative source of clean water, rainwater can meet up to 82.3% of clean water demand [7], [8]. Other studies related to the implementation of rainwater harvesting system planning have produced results in the form of simple rainwater storage designs that can be used at local research sites [9], [10].

Based on rainfall data for the Sepaku District, the intensity of rainfall over the last 10 years, namely data from 2015 to 2024, was 1334–3152 mm/year or 111–263 mm/month [11]. This data shows that rainfall in the Sepaku District has a high intensity and can produce abundant rainwater supplies. High rainfall has benefits



for life, including restoring groundwater reserves, maintaining ecosystem balance, and being a source of clean water in addition to surface water and groundwater. Therefore, this study analysed the potential of rainwater discharge and planned a rainwater harvesting system as an alternative source of clean water in the Sepaku District.

## 2. Materials and Methods

### Analysis Method of Rainwater Discharge Potential

The study was conducted in Sepaku District, North Penajam Paser Regency, East Kalimantan Province, Indonesia. The RWH planning was focused on public facilities located in several villages within the study area. One public facility was selected from each village as the representative site for the RWH system design. The locations of the selected public facilities are presented in Table 1 and Figure 1.

Table 1. Location of Rainwater Harvesting Plan

	Sub-district	Public Facility
1	Karang Jinawi	BPD Sekretariat Office
2	Bukit Raya	Village Office
3	Tengin Baru BPD Sekretariat Office	BPD Sekretariat Office
4	Argo Mulyo Village Office	Village Office
5	Suko Mulyo	Raudhatul Jannah Mosque
6	Semol Dua	Village Multipurpose Building
7	Wonosari	Village Office

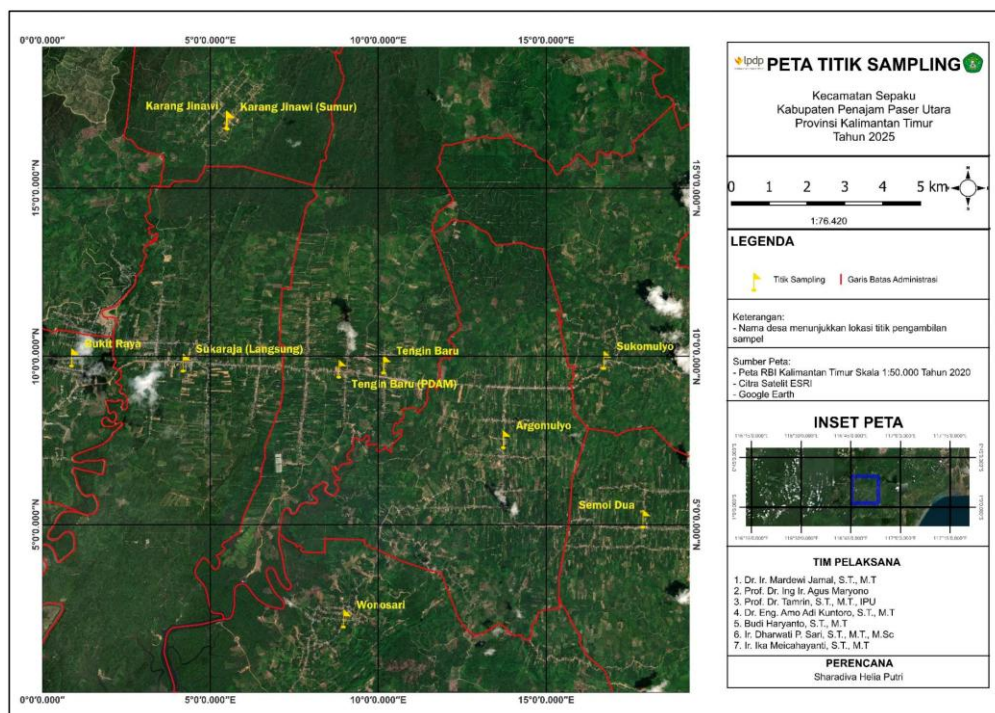


Figure 1. Location of Rainwater Harvesting Plan

Rainwater harvesting requires a well-designed system in order to maximise the amount of rainwater collected. The design of a rainwater harvesting system is influenced by the amount of rainwater that can be collected, the amount of clean water required, the capacity of the storage tank, and so on. Calculating the potential rainfall is very important in the process of planning a rainwater harvesting installation. The potential



rainfall discharge is used as the basis for calculating the design of rainwater harvesting, including water tank capacity, gutter size, pipe dimensions, and the required pipe length [12]. The potential rainfall supply can be calculated using Equation 1.

$$Q_{supply} = A \times C \times h \quad (1)$$

where  $Q_{supply}$  is the potential rainwater discharge (L/month or  $m^3$ /year),  $A$  is the roof area of the building ( $m^2$ ),  $C$  is the runoff coefficient, and  $h$  is the rainfall (mm/month). Reliable rainfall calculations can provide estimates of the amount of rainfall available for use in the planning process. The rainfall data used in this study were obtained from the Meteorology, Climatology, and Geophysics Agency (BMKG) rainfall station in Sepaku District, which is located in Karang Jinawi Village. The dataset consisted of monthly rainfall and rainy-day records spanning a 10-year period (2015–2024).

Reliable rainfall is analysed by sorting data based on rainfall magnitude, then calculating the probability through column plotting to select rainfall that is close to 80% [13]. Reliable rainfall is calculated using Equation 2.

$$P (\%) = \frac{m}{n+1} \times 100\% \quad (2)$$

where  $P\%$  is the probability,  $m$  is the serial number, and  $n$  is the amount of data.

The catchment area will affect the amount of rainwater available. Roofs are commonly used as catchment areas. The catchment area can be assumed to be equal to the floor area of the building. The catchment area of a rectangle is calculated using the formula for the area of a rectangle, which is the multiplication of the length and width, while roofs with multiple sections are calculated by the sum of the roof area of each section [14]. The roof dimensions (length and width) were determined through direct field observations and on-site measurements. The roof geometry was further delineated by coordinate-based digitisation using GIS, allowing more accurate estimation of the roof catchment area.

The runoff coefficient is needed to calculate the potential rainwater that can be harvested for each building. The runoff coefficient value is determined by the shape and type of roofing material used [15]. The runoff coefficient for roofs with two types of materials is calculated using the runoff coefficient value and the roof area of each material, as well as the total roof area, to obtain an average value as the combined roof runoff coefficient value.

The first rainwater that falls on the roof is of poor quality due to the accumulation of pollutants trapped on the roof. Therefore, this water is drained into the drainage system to maintain the quality of the harvested water [3]. The first flush volume is calculated using Equation 3.

$$V_{ff} = H_d \times A \quad (3)$$

where  $V_{ff}$  is the first flush volume ( $m^3$ ),  $H_d$  is the diverter height (0.5–1.5) mm, and  $A$  is the roof area ( $m^2$ ).

Total water demand is calculated by multiplying the number of occupants (persons) in a building by the standard water demand (L/person.day) according to the type of building at the research location [16]. The standard clean water demand for public facilities in mosques is 3000 L/unit.day and for public facilities in offices is 50 L/person.day [17], [18].

### **Method of Rainwater Harvesting System Plan**

Rainwater harvesting system planning includes determining the capacity of tanks, gutters, and pipe dimensions. Tank capacity is determined by calculating the potential rainfall and number of rainy days, thereby obtaining the maximum rainfall in litres per day. Gutters are determined in accordance with SNI 03-7065-2005, which stipulates a minimum slope of 2% [17]. The dimensions of the gutters and pipes are then determined based on the average rainfall to obtain the maximum roof area. The maximum roof area is

calculated using Equation 4 based on SNI 8153:2015 concerning the size of horizontal and vertical rainwater pipes for a roof slope of 2% [19][20].

$$Y = Y_1 + \frac{X - X_1}{X_2 - X_1} \cdot Y_2 - Y_1 \tag{4}$$

where Y is the maximum roof area (m<sup>2</sup>), Y<sub>1</sub> is the roof area in column 1 (m<sup>2</sup>), Y<sub>2</sub> is the roof area in column 2 (m<sup>2</sup>), X is the local rainfall value (mm), X<sub>1</sub> is the rainfall value in column 1 (mm), and X<sub>2</sub> is the rainfall value in column 1 (mm).

This study has several limitations. The RWH planning was developed based on the proposed installation conditions at the selected sites rather than actual implementation and operational evaluation. In addition, only one public facility was selected in each village as the representative site for RWH system planning. These facilities were intended to serve as demonstration sites to showcase the feasibility and potential benefits of rainwater harvesting. It is expected that the successful implementation of these pilot systems will encourage local communities to adopt RWH technology more widely to supplement their domestic clean water supply. Consequently, the findings should be interpreted as a planning framework for pilot-scale implementation and may require further validation before being generalized to all public facilities or residential buildings within the study area.

### 3. Results and Discussion

#### Result of Rainwater Discharge Potential Analysis




##### 1) Analysis of Reliable Rainfall

The rainfall data collected over a ten-year period (2015–2024) were processed to determine reliable rainfall by arranging the annual rainfall records in descending order. Subsequently, reliable rainfall with an exceedance probability of approximately 80% was determined using the Weibull probability method [13]. The probabilistic analysis identified the 2015 rainfall record as the representative reliable rainfall, with an exceedance probability of 81.82% and an annual rainfall of 1,813 mm/year. Therefore, the 2015 rainfall data were adopted as the basis for the subsequent RWH system planning and design.





##### 2) Analysis of Roof Area

The roof area was obtained from processing the length and width data, which is found in Table 1. The results of the roof area calculation were used in calculating rainwater supply and first-flush volume. The roof area will affect the amount of rainwater that can be harvested; the larger the area, the more water will be obtained [14].

**Table 2.** Roof Area

Location of Rainwater Harvesting Plan		Type of Roof <sup>1</sup>	Roof Area <sup>2</sup> (m <sup>2</sup> )
1	Karang Jinawi BPD Secretariat Office		78.10
2	Bukit Raya Village Office		101.38
3	Tengin Baru BPD Secretariat Office		100.87



Location of Rainwater Harvesting Plan		Type of Roof <sup>1</sup>	Roof Area <sup>2</sup> (m <sup>2</sup> )
4	Argo Mulyo Village Office		93.24
5	Raudhatul Jannah Suko Mulyo Mosque		331.50
6	Semoi Dua Village Multipurpose Building		142.00
7	Wonosari Village Office		286.75

Description: <sup>1</sup>Digitasi; <sup>2</sup>Observation and Calculation

### 3) Analysis of Runoff Coefficient Determination

The runoff coefficient was determined by the shape and type of the catchment area. The runoff coefficient value for zinc roofs is 0.8 [4]. The runoff coefficient for roofs with a combination of zinc and cement is determined through average calculations [15]. The runoff coefficient value used for zinc roofs is 0.8, while for cement roofs it is 0.65 [21]. The runoff coefficient for the Karang Jinawi BPD Secretariat Office, Bukit Raya Village Office, Tengin Baru BPD Secretariat Office, Semoi Dua Village Multipurpose Building, and Wonosari Village Office, which have zinc roofs, is 0.8. The runoff coefficient for the Argo Mulyo Village Office, which has a zinc and slab roof, is 0.77, and for the Raudhatul Jannah Suko Mulyo Mosque, which has a zinc and clay roof, is 0.75.

### 4) Analysis of First Flush

The first flush volume is calculated based on the roof area and diverter height. The diverter height used is 0.5 mm [22]. The first flush volume can be influenced by the diverter height used and the roof area at the research location. The results of the first flush volume calculation are shown in Table 2.

**Table 3.** First Flush Calculations

Location of Rainwater Harvesting Plan		Roof Area <sup>1</sup> (m <sup>2</sup> )	Diverter Height <sup>2</sup> (mm)	First Flush <sup>3</sup> (m <sup>3</sup> )	First Flush <sup>3</sup> (L)
1	Karang Jinawi BPD Secretariat Office	78.10	0.5	0.039	39
2	Bukit Raya Village Office	101.38	0.5	0.051	51
3	Tengin Baru BPD Secretariat Office	100.87	0.5	0.050	50
4	Argo Mulyo Village Office	93.24	0.5	0.046	46
5	Raudhatul Jannah Suko Mulyo Mosque	331,5	0.5	0.166	166
6	Semoi Dua Village Multipurpose Building	142.00	0.5	0.071	71

*Meicahayanti et al., Rainwater Harvesting Planning as an Alternative for Clean Water Supply in Public Facilities in Sepaku District: A Study of Supply Potential using Probability Methods, pp. 63-74*



Location of Rainwater Harvesting Plan		Roof Area <sup>1</sup> (m <sup>2</sup> )	Diverter Height <sup>2</sup> (mm)	First Flush <sup>3</sup> (m <sup>3</sup> )	First Flush <sup>3</sup> (L)
7	Wonosari Village Office	286.75	0.5	0.143	143

Description: <sup>1</sup>Table 1; <sup>2</sup>[3]; <sup>3</sup>Calculation Result

### 5) Analysis of Rainwater Potential Discharge

The results of the rainfall supply potential calculations using Equation 3 will then be subtracted from the first flush value. The results are shown in Table 3.

Table 4. Rainwater Potential Discharge Calculations

Location of Rainwater Harvesting Plan		Q <sub>max</sub> Rainwater (L/month)	Q <sub>max</sub> Rainwater (L/day)	Q <sub>average</sub> Rainwater (L/month)	Q <sub>total</sub> Rainwater (m <sup>3</sup> /year)
1	Karang Jinawi BPD Secretariat Office	26453.3	1693.40	9111.4	109.3
2	Bukit Raya Village Office	34332.1	2197.79	11824.2	141.9
3	Tengin Baru BPD Secretariat Office	34172.1	2187.48	11771.0	141.3
4	Argo Mulyo Village Office	30359.9	1944.67	10451.4	125.4
5	Raudhatul Jannah Suko Mulyo Mosque	105081.3	6727.69	36165.9	434.0
6	Semoi Dua Village Multipurpose Building	48095.4	3078.82	16565.5	198.8
7	Wonosari Village Office	97128.6	6217.64	33454.9	401.5

Description: Calculation Result

Based on Table 3, it can be seen that rainwater in the Sepaku District has a sufficient quantity to be utilised as an additional water source or an alternative source of raw water. The minimum potential rainwater discharge at all research locations was obtained in September, which was 0.0 L/month, where the rainfall in that month was 0 mm/month. Meanwhile, the maximum potential rainfall discharge in all research locations was obtained in April, with varying values, where the rainfall in that month was 434 mm/month, which was the highest rainfall in 2015. Factors that influence rainfall discharge include high rainfall, catchment area, runoff coefficient, and first flush amount. Rainwater flow is proportional to the catchment area; the larger the catchment area, the more abundant the rainwater obtained [9].

### 6) Water Demand Analysis

The results in Table 4 show that the highest total water requirement is at the Raudhatul Jannah Suko Mulyo Mosque at 1,095.00 m<sup>3</sup>/year, while the lowest is at the Karang Jinawi BPD Secretariat Office at 127.75 m<sup>3</sup>/year. The standard water requirement for mosques is 3,000 litres/unit.day, while for offices it is 50 litres/person.day [23], [24].

Table 5. Water Demand Calculations

Location of Rainwater Harvesting Plan		Number of Occupants (person)	Standard of Water Demand		Q <sub>total</sub> Water Demand <sup>3</sup>	
					L/day	(m <sup>3</sup> /year)
1	Karang Jinawi BPD Secretariat Office	7	50 <sup>1</sup>	L/person.day	350	127.8
2	Bukit Raya Village Office	8	50 <sup>1</sup>	L/person.day	400	146.0
3	Tengin Baru BPD Secretariat Office	8	50 <sup>1</sup>	L/person.day	400	146.0
4	Argo Mulyo Village Office	22	50 <sup>1</sup>	L/person.day	1100	401.5

Meicahayanti et al., Rainwater Harvesting Planning as an Alternative for Clean Water Supply in Public Facilities in Sepaku District: A Study of Supply Potential using Probability Methods, pp. 63-74



Location of Rainwater Harvesting Plan		Number of Occupants (person)	Standard of Water Demand		Q <sub>total</sub> Water Demand <sup>3</sup>	
					L/day	(m <sup>3</sup> /year)
5	Raudhatul Jannah Suko Mulyo Mosque	-	3,000 <sup>2</sup>	L/unit.day	3000	1,095.0
6	Semoi Dua Village Multipurpose Building	19	50 <sup>1</sup>	L/person.day	950	346.8
7	Wonosari Village Office	18	50 <sup>1</sup>	L/person.day	900	328.5

Description: <sup>1</sup>[18]; <sup>2</sup>[17]; <sup>3</sup>Calculation Result

The results of the calculations can be compared between the rainfall discharge values (Table 3) and the clean water demand at each research location (Table 4). This aims to determine whether the harvested rainwater can meet water requirements. The comparison results are shown in Table 5. Based on the analysis results, it was found that out of the seven locations, only the Wonosari Village Office had a higher rainfall supply than water demand. This indicates that the rainfall catchment area is not yet sufficient to meet general water demand. Planning on a communal scale needs to be considered so that the supply from all buildings can be collected to support water shortages in certain buildings.

**Table 6.** Comparison of Rainwater Potential and Clean Water Demand

Location of Rainwater Harvesting Plan		Q <sub>total</sub> Rainwater <sup>1</sup> (m <sup>3</sup> /year)	Q <sub>total</sub> Water Demand <sup>2</sup> (m <sup>3</sup> /year)
1	Karang Jinawi BPD Secretariat Office	109.3	127.8
2	Bukit Raya Village Office	141.9	146.0
3	Tengin Baru BPD Secretariat Office	141.3	146.0
4	Argo Mulyo Village Office	125.4	401.5
5	Raudhatul Jannah Suko Mulyo Mosque	434.0	1,095.0
6	Semoi Dua Village Multipurpose Building	198.8	346.8
7	Wonosari Village Office	401.5	328.5

Description: <sup>1</sup>Table 3; <sup>2</sup>Tabel 4

## Rainwater Harvesting Plan

### 1) Determine the Capacity of The Water Tank

The capacity of rainwater harvesting tanks can be determined using the highest daily rainfall discharge based on Table 3. The storage tank capacity is then determined based on the highest daily rainfall discharge and the capacity of water tanks sold on the market. The water tank capacity values at the research location are shown in Table 6.

### 2) Determine Gutter and Pipe Dimensions

The slope criteria for rainwater gutters use a minimum slope of 2% [17]. Rainwater collected in the gutters will be drained into a storage tank through a vertical pipe [25]. The dimensions of the rainwater pipes are calculated based on the maximum roof area, as shown in Table 6.

### 3) Rainwater Harvesting System Design


The detailed design of rainwater harvesting at all research locations is shown in Table 6. Rainwater harvesting planning includes tank capacity, gutter size, horizontal pipe dimensions, vertical pipe dimensions, first flush diverter pipe diameter, and first flush diverter height. The first flush volume obtained ranged from 0.039 m<sup>3</sup> to 0.143 m<sup>3</sup>. Therefore, a 6-inch first flush diverter pipe was used [26]. The size of the first flush diverter pipe can be increased if the first flush volume discharged is greater [27].

**Table 7.** Detail Design of Rain Water Harvesting System

Location of Rainwater Harvesting Plan		Capacity of Tank <sup>1</sup> (m <sup>3</sup> )	Gutter Size <sup>2</sup> (inch)	Horizontal Pipe Diameter <sup>3</sup> (mm)	Vertical Pipe Diameter <sup>3</sup> (mm)	First Flush Diverter Pipe Diameter <sup>1</sup> (inch)	First Flush Diverter Height <sup>1</sup> (m)
1	Karang Jinawi BPD Secretariat Office	2.2	4	100	75	6	2,21
2	Bukit Raya Village Office	2.2	4	100	75	6	2,87
3	Tengin Baru BPD Secretariat Office	2.2	4	100	75	6	2,86
4	Argo Mulyo Village Office	2.2	4	100	75	6	2,64
5	Raudhatul Jannah Suko Mulyo Mosque	7.5	6	150	125	10	3,38
6	Semai Dua Village Multipurpose Building	3.2	4	100	75	10	1,45
7	Wonosari Village Office	7.5	5	125	100	10	2,92

Description: <sup>1</sup> Calculation Result; <sup>2</sup> [17]; <sup>3</sup>[19]

The design used is adjusted to the results of calculations at each research location. The rainwater harvesting design that has been implemented is expected to obtain abundant rainwater availability so that it can be used as an alternative or additional water source at all research locations. The typical of rainwater harvesting plan is shown in Figures 2 to 5.

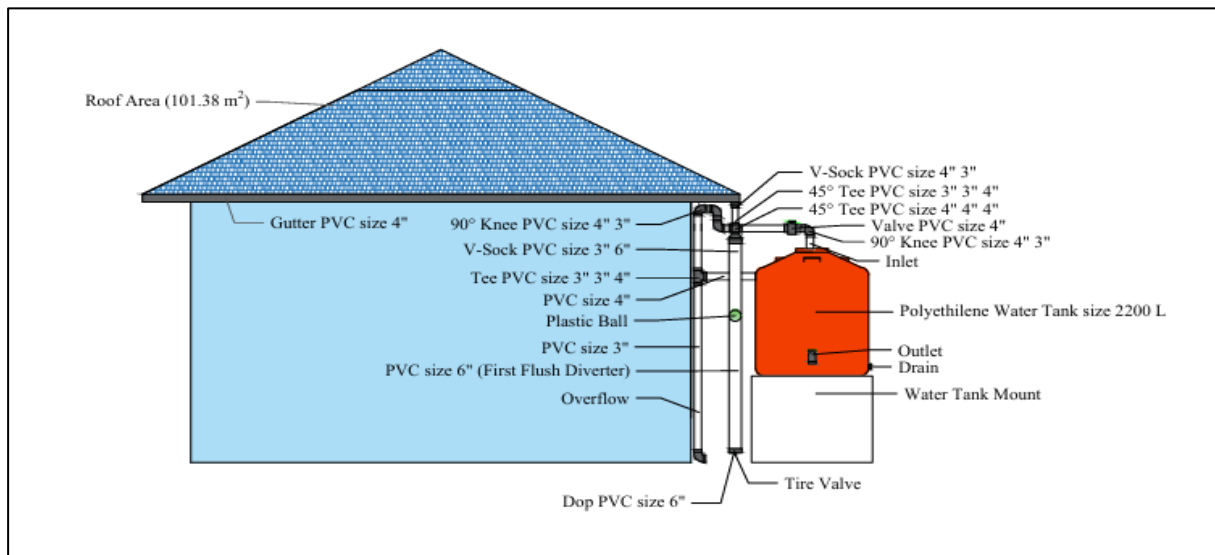

**Figure 2.** Details of Rainwater Harvesting Typical Design at Location 1 to 4 (Table 6)

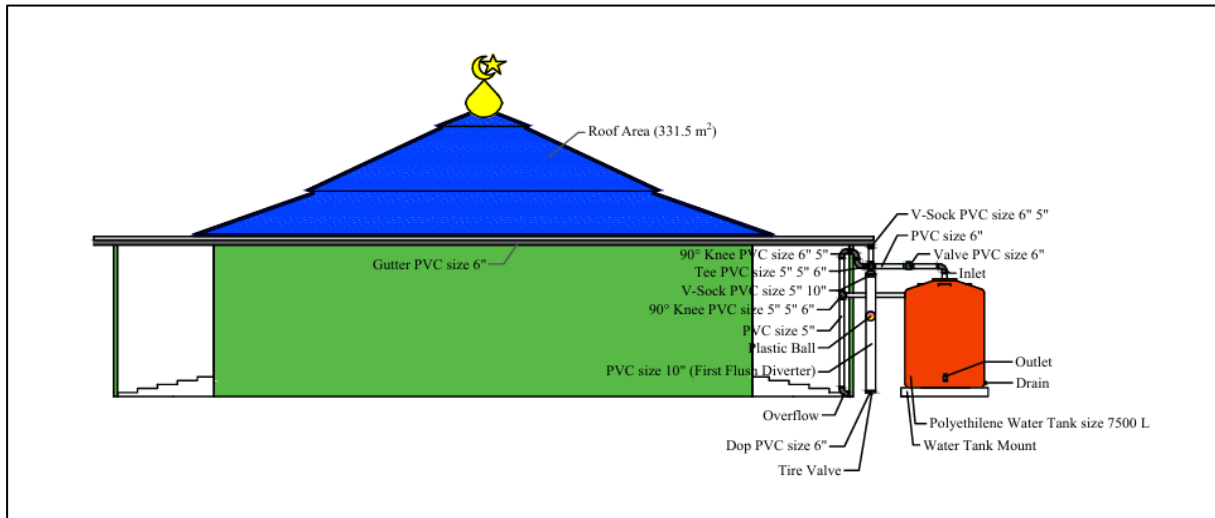


Figure 3. Details of Rainwater Harvesting Typical Design at Raudhatul Jannah Suko Mulyo Mosque

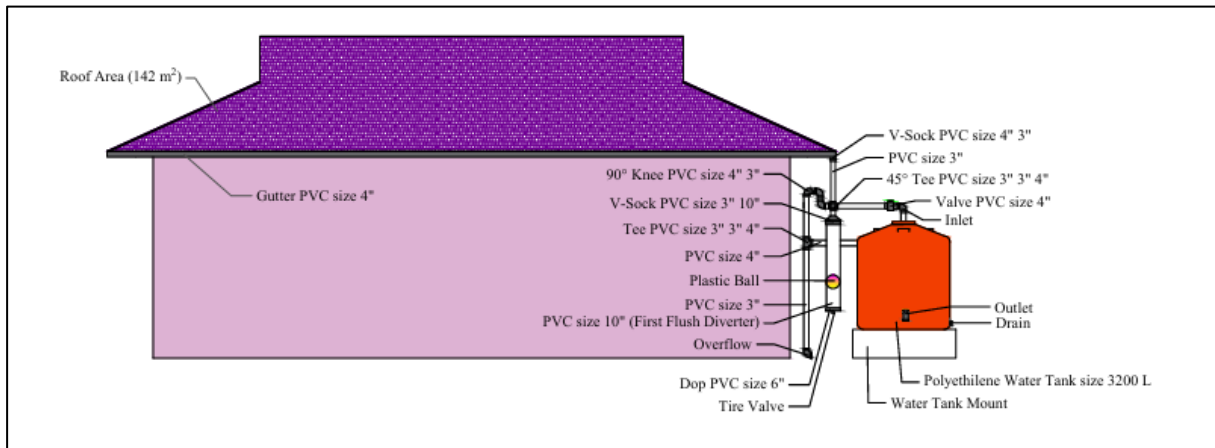


Figure 4. Details of Rainwater Harvesting Design at the Semoi Dua Village Multipurpose Building

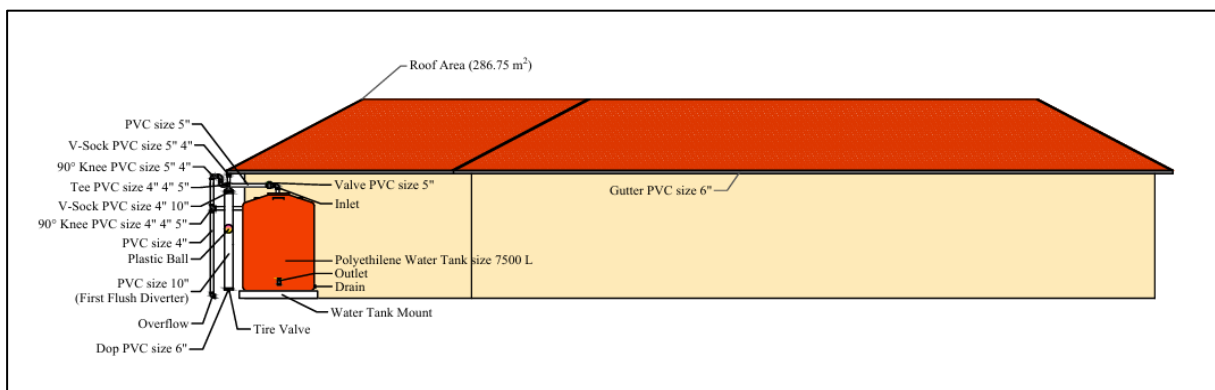


Figure 5. Details of Rainwater Harvesting Design at the Wonosari Village Office



#### 4. Conclusion

The study shows that the average of potential rainfall discharge is 221.7 m<sup>3</sup>/year and at each planning location varies between 109.3 and 434 m<sup>3</sup>/year. This is influenced by the roof area as the catchment area, where the larger the catchment area, the more abundant the rainfall will be. The highest potential discharge was at the Raudhatul Jannah Suko Mulyo Mosque at 434 m<sup>3</sup>/year, and the lowest discharge was at the Karang Jinawi BPD Secretariat Office at 109.3 m<sup>3</sup>/year.

The planned rainwater harvesting system consists of gutters, horizontal pipes, vertical pipes, first flush pipes, and storage tanks. These components are influenced by the potential rainwater discharge that can be collected. The tank capacity is planned to be 2.2 m<sup>3</sup>, except for the Raudhatul Jannah Suko Mulyo Mosque, Semoi Dua Village Multipurpose Building, and the Wonosari Village Office, which will use tank capacities of 7.5, 3.2 and 7.5 m<sup>3</sup>, respectively. The gutter size is 4 inch, but Raudhatul Jannah Suko Mulyo Mosque use 6 inch, and Wonosari Village Office use 5 inch. The planned diameters of the horizontal and vertical pipes is 100 mm and 75 mm. Due to the significant difference in potential discharge, the Raudhatul Jannah Suko Mulyo Mosque is planned to use 150 mm horizontal pipes and 125 mm vertical pipes, while the Wonosari Village Office will use 125 mm horizontal pipes and 100 mm vertical pipes. At four locations, namely the Karang Jinawi BPD Secretariat Office, Bukit Raya Village Office, Tengin Baru BPD Secretariat Office, and Argo Mulyo Village Office, it is planned to use 6-inch first-flush pipes with pipe heights of 2.21 m, 2.87 m, 2.86 m, and 2.64 m, respectively. At three other locations, namely the Raudhatul Jannah Suko Mulyo Mosque, the Semoi Dua Village Multipurpose Building, and the Wonosari Village Office, it is planned to use 10-inch first flush pipes with pipe heights of 3.38 m, 1.45 m, and 2.92 m, respectively.

#### Acknowledgments

The authors would like to express gratitude for the support given to this research by the Ministry of Higher Education, Science and Technology, as well as the Education Fund Management Institution through the RPRB Funding Programme for the Inclusiveness Scheme with contract number: 061/E5/PG.02.00/PRPB.INKLUSIVITAS/2024.

#### References

- [1] E. Sriwati, B. Setiawati, and N. Tahir, "Peran Pemerintah Daerah dalam Pembangunan Infrastruktur," *Kajian Ilmiah Mahasiswa Administrasi Publik (KIMAP)*, vol. 5, no. 1, pp. 104–116, 2024, doi: <https://doi.org/10.26618/kimap.v5i1.14058>.
- [2] Perumdam Danum Taka, "Pelayanan Jaringan Perpipaan," Perumda Air Minum Danum Taka, Sepaku, Penajam Paser Utara, 2025.
- [3] R. Ayatri, M. Fajar, and A. Zurfi, "Perencanaan Sistem Pemanenan Air Hujan sebagai Alternatif Penyediaan Air Bersih Gedung Asrama TB 4 ITERA," *Jurnal Sumber Daya Alam dan Lingkungan*, vol. 8, no. 2, pp. 93–101, 2021, doi: <https://dx.doi.org/10.21776/ub.jsal.2021.008.02.5>.
- [4] G. B. J. Murda, A. Herison, A. Zakaria, D. Indriana K., and O. Taufik P., "Pemanenan Air Hujan Dengan Metode Roof Catchment sebagai Pengawetan Air Bangunan Gedung Institut Teknologi Sumatera," *Teras Jurnal: Jurnal Teknik Sipil*, vol. 14, no. 2, pp. 413–427, 2024, doi: <https://doi.org/10.29103/tj.v14i2.1127>.
- [5] T. W. Sudinda, "Pemanfaatan Air Hujan Untuk Memenuhi Kebutuhan Air Baku Jangka Panjang Ibu Kota Negara," *Indonesian Journal of Construction Engineering and Sustainable Development (CESD)*, vol. 3, no. 1, pp. 1–9, 2022.
- [6] S. Rizky, I. Ilham, and Moch. Assiddieq, "Perencanaan Sistem Pemanenan Air Hujan (Rainwater Harvesting) di Masjid Al Mu'minin Kota Kendari," *Teluk*, vol. 2, no. 1, pp. 01–07, Jun. 2022, doi: [10.51454/teluk.v2i1.510](https://doi.org/10.51454/teluk.v2i1.510).
- [7] A. A. Cahyani and N. Helda, "Analisis Sistem Pemanenan Air Hujan (PAH) untuk Memenuhi Kebutuhan Air Bersih pada Masjid Raya Sabilal Muhtadin di Banjarmasin," *JTB*, vol. 11, no. 02, pp. 56–61, Nov. 2022, doi: [10.20527/jtb.v11i02.219](https://doi.org/10.20527/jtb.v11i02.219).



- [8] R. N. P. R. Djalle, Y. K. D. Sutopo, and S. A. Ekawati, "Konsep Pemanen Air Hujan (RainwaterHarvesting) sebagai Alternatif Sumber Daya Air Bersih di Kampung Lakkang Kota Makassar," *Jurnal WKM*, vol. 10, no. 2, pp. 102–110, 2022, doi: <https://doi.org/10.20956/jwkm.v10i2.1603>.
- [9] I. Dharmawan and W. A. Pranoto, "Analisis Pemanfaatan Air Hujan Untuk Kebutuhan Pertamanan dan Sanitasi di Gereja Kalvari Jakarta," *Jurnal Mitra Teknik Sipil*, vol. 6, no. 4, pp. 1117–1130, Nov. 2023, doi: 10.24912/jmts.v6i3.24955.
- [10] M. Dirgawati, M. R. Sururi, and Y. S. Ridwan, "Perencanaan Sistem Pemanenan Air Hujan Sebagai Teknologi Alternatif Penyediaan Air Bersih Di Kawasan Pemukiman Kepadatan Tinggi," *Jurnal Teknologi Lingkungan*, vol. 25, no. 2, pp. 246–256, 2024, doi: <https://doi.org/10.55981/jtl.2024.290>.
- [11] BMKG, "Data Curah Hujan Kecamatan Sepaku Kalimantan Timur 10 Tahun: 2015-2024," Badan Meteorologi, Klimatologi, dan Geofisika, 2025.
- [12] T. H. Pamungkas, I. M. Kariyana, and I. G. A. Putra, "Potensi Pemanenan Air Hujan dalam Memenuhi Kebutuhan Air di Desa Seraya," *JRS-Unand*, vol. 19, no. 1, p. 42, Mar. 2023, doi: 10.25077/jrs.19.1.42-43.2023.
- [13] Suhardi, "Kajian Potensi Air Kali Bekasi untuk Penyediaan Air Baku," *BENTANG: Jurnal Teoritis dan Terapan Bidang Rekayasa Sipil*, vol. 8, no. 2, pp. 79–86, 2020, doi: <https://doi.org/10.33558/bentang.v8i2.2122>.
- [14] I. C. Juliana, *Dasar-Dasar Penerapan Sistem Rainwater Harvesting (RWH)*. Palembang: Jurusan Teknik Sipil dan Perencanaan Program Studi Teknik Sipil Universitas Sriwijaya, 2019. [Online]. Available: <http://dx.doi.org/10.13140/RG.2.2.13044.91527>
- [15] T. Herdiaprila and E. Hartati, "Penentuan Koefisien Limpasan Rata-Rata (Cr) Tata Guna Lahan Kelurahan Sukamiskin Kecamatan Arcamanik Kota Bandung," *Jurnal Serambi Engineering*, vol. VIII, no. 2, pp. 5286–5296, 2023.
- [16] A. Suheri, C. Kusmana, M. Y. J. Purwanto, and Y. Setiawan, "Model Prediksi Kebutuhan Air Bersih Berdasarkan Jumlah Penduduk di Kawasan Perkotaan Sentul City," *JSIL*, vol. 4, no. 3, pp. 207–218, Dec. 2019, doi: <https://journal.ipb.ac.id/index.php/jsil/article/view/26639>.
- [17] BSN, *SNI 03-7065-2005: Tata Cara Perencanaan Sistem Plambing*, Jakarta., 2005.
- [18] Kementerian PU, *Penyelenggaraan Pengembangan Sistem Penyediaan Air Minum*, 18/PRT/M/2007, 2007. [Online]. Available: <https://jdih.pu.go.id/internal/assets/assets/produk/PermenPUPR/2007/06/permen18-2007.pdf>
- [19] BSN, *SNI 8153:2015: Sistem Plambing pada Bangunan Gedung*, Jakarta., 2015.
- [20] P. S. Komala and Y. Maisuara, "Perencanaan Sistem Plambing Air Hujan Pengembangan Hotel Grand Zuri Kota Padang," *CIVED*, vol. 8, no. 3, p. 199, Nov. 2021, doi: 10.24036/cived.v8i3.115791.
- [21] R. Heryani, "Analisis Kerawanan Banjir Berbasis Spasial Menggunakan Analytical Hierarchy Process (AHP) Kabupaten Maros," *Jurnal FMIPA*, 2013.
- [22] H. Widiantoni, M. Widiastuti, and B. Haryanto, "Kapasitas Penampung Optimum dan Payback Period Penerapan Sistem Pemanenan Air Hujan Pada Permukiman," in *Prosiding Nasional Rekayasa Teknologi Industri dan Informasi XVII Tahun 2022 (ReTII)*, 2022, pp. 406–411. [Online]. Available: <https://journal.itny.ac.id/index.php/ReTII/article/view/3670/1479>
- [23] C. Larasati *et al.*, "Analisis Ketersediaan Air Permukaan dan Proyeksi Kebutuhan Air DAS Bodri Tahun 2040," *Majalah Geografi Indonesia*, vol. 35, no. 1, pp. 84–94, 2021, doi: <https://doi.org/10.22146/mgi.62382>.
- [24] W. B. Putra, N. I. K. Dewi, and T. Busono, "Penyediaan Air Bersih Sistem Kolektif: Analisis Kebutuhan Air Bersih Domestik pada Perumahan Klaster," *Jurnal Arsitektur TERRACOTTA*, vol. 2, no. 1, pp. 115–123, 2020, doi: <https://doi.org/10.26760/terracotta.v1i2.4018>.
- [25] H. I. Arsyadi, Mashuri, and A. H. Kiranaratri, "Perencanaan Rainwater Harvesting System dengan Metode Roof Catchment, Studi Kasus: Gedung Kuliah Umum 1 ITERA," *Repository Institut Teknologi Sumatera*, pp. 1–6, 2018.
- [26] A. Maryono, *Memanen Air Hujan*, 2nd ed. Yogyakarta: Gadjah Mada University Press, 2017.



- [27] B. Budiman, R. S. Aminda, and S. Syaiful, "Pemanfaatan Air Hujan Bersih dan Layak Menggunakan Alat Filtrasi Sederhana di Taman Pegelaran Ciomas Bogor," *JPMUJ*, vol. 1, no. 1, p. 1, Feb. 2023, doi: 10.32832/jpmuj.v1i1.1668.